

## Pet Fountain Series

### MODEL M-PM14

PET FOUNTAIN WITH HOSE BIBB  
AND HOSE HOLDER

#### STANDARD FEATURES

- 100 mesh inlet strainer
- Hose holder (hose furnished locally)
- Pushbutton requiring less than 5 pounds for activation
- Chrome plated hose bibb with vacuum breaker
- Stainless Steel, anti-rotation, non-squirt bubbler for pet fountain
- Vandal resistant stainless steel access panel
- 18 gage, 304 stainless steel basin
- Heavy duty, 304 stainless steel polished to a satin finish

#### SUGGESTED SPECIFICATIONS

Pet fountain shall be Murdock model M-PM14. Model shall include a pet fountain, hose bibb with vacuum breaker and a hose holder. Pet fountain pushbutton shall be self-closing requiring less than 5 pounds of force to activate the internally mounted valve.

Pet fountain bubbler shall be stainless steel with a non-squirt feature and operate on a water pressure range of 20-105 psig.

Unit shall be constructed of 14 gage type 304 stainless steel polished to a satin finish with 18 gage pet fountain bowl. Bottom plate shall be 3/16" thick and include three mounting holes with two additional mounting holes for pet fountain. 1/2" expansion anchor bolts shall be furnished. All other exposed fasteners shall be vandal resistant stainless steel screws.



Model M-PM14 Shown

#### MODEL:

(Must Specify)

- |                                 |                                |
|---------------------------------|--------------------------------|
| <input type="checkbox"/> M-PM14 | Satin stainless finish (Shown) |
| <input type="checkbox"/> M-PM15 | Green powder-coated            |
| <input type="checkbox"/> M-PM16 | Red powder-coated              |
| <input type="checkbox"/> M-PM17 | Blue powder-coated             |

Custom color finishes available upon request

#### OPTIONS

(additional costs may be incurred)

- |                                |  |
|--------------------------------|--|
| <input type="checkbox"/> -FRU1 | Freeze Resistant, 1 valve <sup>1,2</sup> |
| <input type="checkbox"/> -IAP  | In-ground anchor plate <sup>1</sup>      |
| <input type="checkbox"/> -LOGO | Customer Specified logo <sup>1</sup>     |

#### Options Notes:

<sup>1</sup> See separate option sheet.

<sup>2</sup> This option does not provide freeze resistance for Hose Bibb.

Complies with the following standards:



Member of  
U.S. Green  
Building  
Council



Recyclable  
Product

**WARNING:** Cancer and Reproductive Harm - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)


MURDOCK MFG. • 15125 Proctor Avenue • City of Industry, CA 91746 USA  
Phone 800-453-7465 • [www.murdockmfg.com](http://www.murdockmfg.com)

Member of  
MORRIS GROUP  
INTERNATIONAL

# Pet Fountain Series

**MODEL M-PM14**  
PET FOUNTAIN W/ HOSE BIBB  
AND HOSE HOLDER

\* Valve specifications:  
Minimum/Maximum Pressure  
30 to 100 psi.

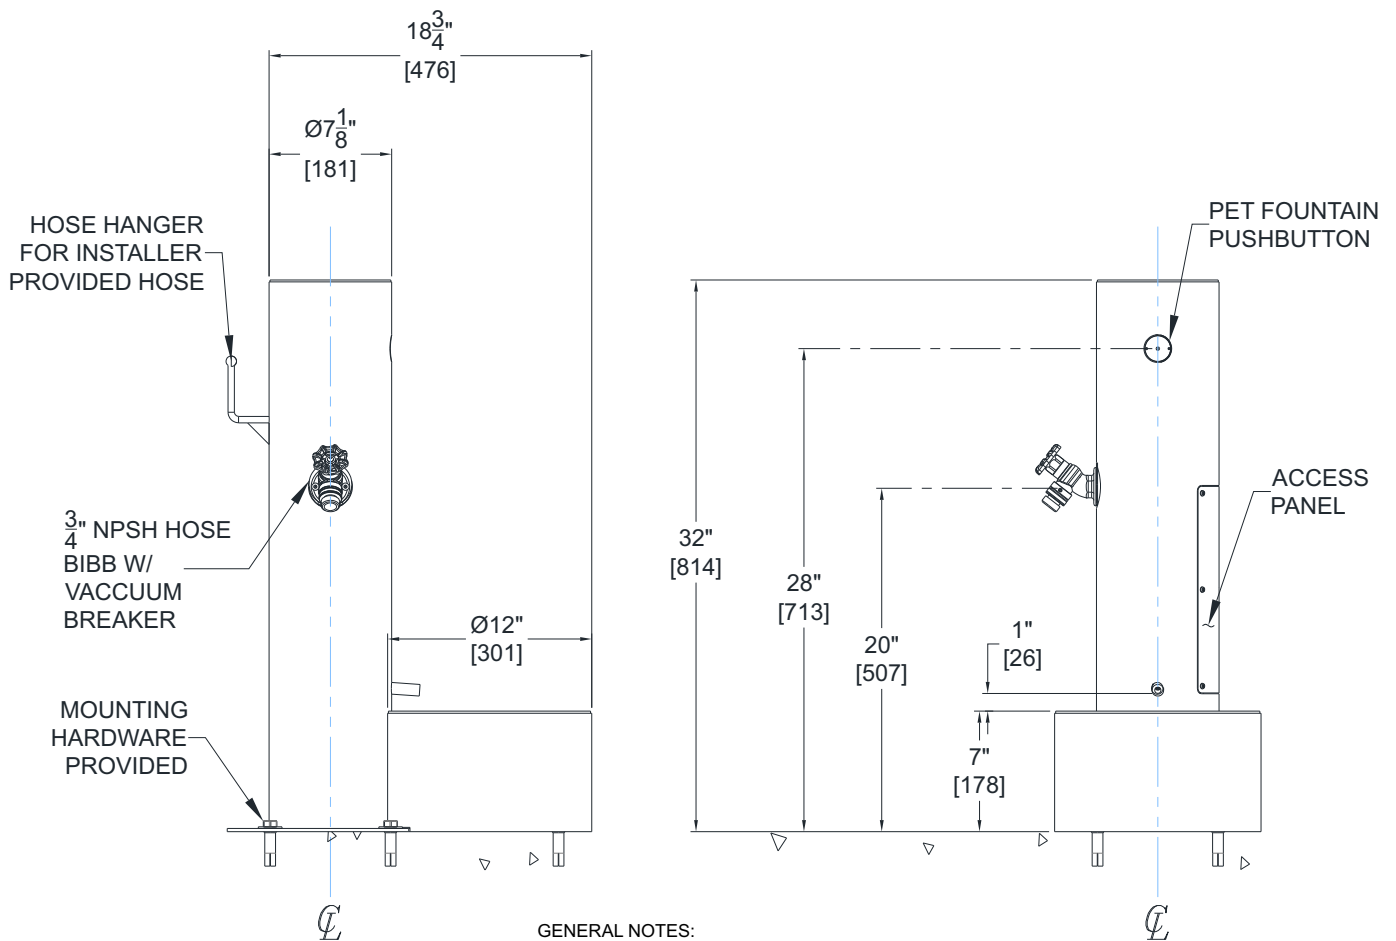

GENERAL NOTES:  
1. ALL DIMENSIONS ARE IN INCHES [MM].

Murdock Mfg.™ warrants that its products are free from defects in material or workmanship under normal use and service for a period of one year from date of shipment. Murdock's liability under this warranty shall be discharged solely by replacement or repair of defective material, provided Murdock™ is notified in writing within one year from date of shipment, F.O.B. Industry, California.

|   |  |                |  |
|---|--|----------------|--|
| <b>SELECTION SUMMARY &amp; APPROVAL FOR MANUFACTURING</b> | Model Number & Options _____                 | Quantity _____ | All dimensions are subject to manufactures tolerance of plus or minus 1/2" nominal and subject to change without notice. Murdock assumes no responsibility for use of void or superseded data. Dimensions may change with the addition of optional accessories. Murdock Mfg.™, Member of Morris Group International™. Please visit <a href="http://www.murdockmfg.com">www.murdockmfg.com</a> for most current specifications. |
|   | Company _____                                |                |  |
|   | Contact _____                                | Title _____    |  |
|   | Signature (Approval for Manufacturing) _____ | Date _____     |  |